



INSTALLATION INSTRUCTIONS

4 Pole Surface Mounted IP65 Rotary Isolators

Important notes

1. This product should be installed, commissioned and maintained by or under the supervision of a competent electrician in accordance with current electrical engineering codes of practice, requirements for electrical installations (BS7671), statutory requirements and any specific instruction issued by the company.
2. After completing the installation and testing of this product it is essential that this leaflet is drawn to the attention of the person responsible for it's future operation and maintenance.
3. It is essential that the supply is disconnected prior to installation.


Installation instructions

To maintain the IP65 rating it is important to adhere to the following recommendations.

1. Use only the existing mounting holes.
2. Use cable glands and sealing washers designed to maintain the IP65 protection.
3. If not installed to the guidance above, warranty will be void.

Box Mounting

This unit is designed to be mounted vertically.

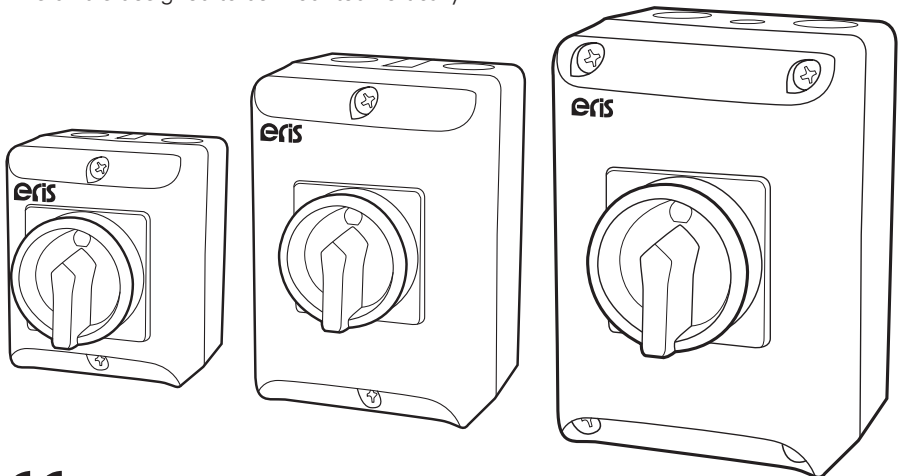

Part No.	AC21	AC23	AC3	Volt	a	b	c	d	e	f	Knockouts
ERS01204	20A	5.5KW	3.7KW	415V	125	100	120	35	80	115	4 x M20/M25
ERS01254	25A	7.5KW	5.5KW	415V	125	100	120	35	80	115	4 x M20/M25
ERS01324	32A	11KW	7.5KW	415V	125	100	120	35	80	115	4 x M20/M25
ERS01404	40A	15KW	11KW	415V	175	114	135	35	90	165	4 x M20/M25
ERS01634	63A	22KW	18.5KW	415V	175	114	135	35	90	165	4 x M20/M25
ERS01804	80A	30KW	22KW	415V	240	160	165	40	142	182	4 x M25/M32, 2 x M20
ERS011004	100A	37KW	30KW	415V	240	160	165	40	142	182	4 x M25/M32, 2 x M20

